



Monitored Residential Riser Test and Drain Valve Pre-wired with Model 120 Ball Valve v4

BS 9251: 2021



General Description

Rapidrop's innovative Monitored Residential Riser Test and Drain Valve Pre-wired with Model 120 Ball Valve is designed to meet requirements of BS 9251: 2021, for use in all domestic and residential properties. The contactless tamper switch is monitoring the fully open position of the valve and will send a signal to FloWatch or any other monitoring system if the valve is being tampered with.

Commonly used in residential systems as a zone or control valve. The full bore design allows minimal flow restriction and pressure loss.

Features

- Monitored full bore isolation valve to meet the requirements of BS 9251: 2021
- Potter vane type flow switch, model VSR-S-EU, LPCB approved as per BS EN 12259-5
- Flow and monitoring switches prewired for quick and easy installation.
- Lockable isolation valve with padlock locking pin - allows using any size leather strap/padlock up to 5.5mm.
- Dual ports enable the flow switch to be mounted on either side. (Right handed version as standard or specify left handed when ordering if required)
- Full bore test valve.
- Factory fitted 18 bar Glycerine filled pressure gauge equipped with isolation valve which allows replacement of the gauge without draining the system.
- Compact and space saving design, quick and easy installation/wiring.
- Fully compatible with CPVC fire sprinkler systems.

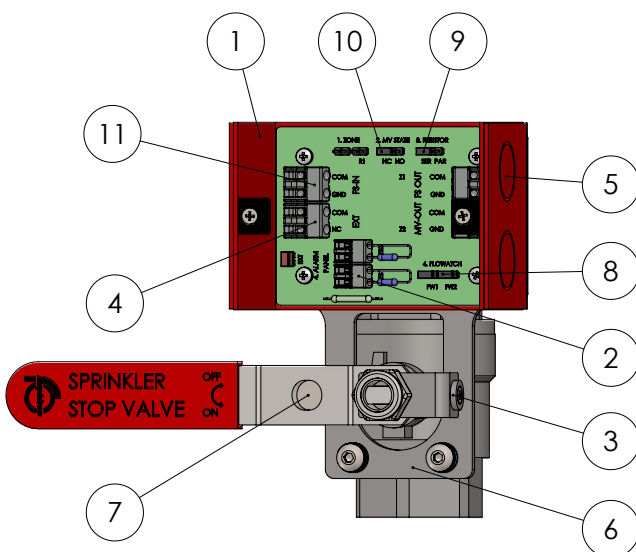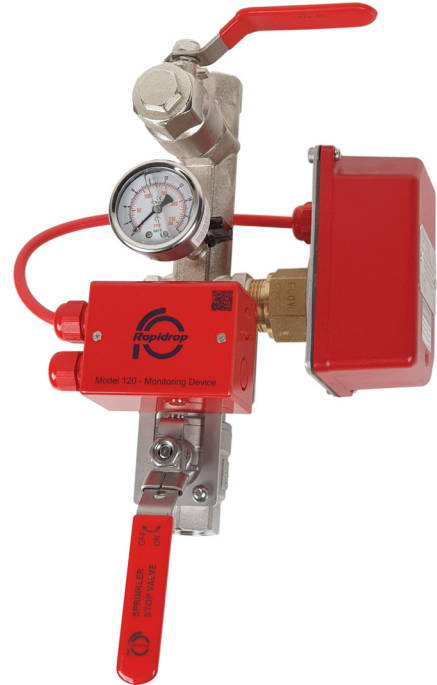

Model 120 Ball Valve Features

- IP54 rated (certified) open style enclosure (1) providing easy access for wiring whilst still obtaining the maximum IP rating
- Push in resistor connectors for custom rating resistors (2)
- Contactless switch for fail-safe operation (3) no mechanical parts, eliminating the possibility of being tampered with
- External switch connection (4) allows an additional input to be connected onto the same zone, commonly found when installed on a combined BCWS (boosted cold water supply)
- Knock out connectors for M20 cable glands - (5) enabling the wiring connection from either side of the enclosure
- Direct/fix switch mounting plate (6) preventing false alarms as seen with other style retro-fit brackets. The monitoring device can also be removed/ replaced in situ
- Lockable handle with padlock locking pin - allows using any size leather strap/padlock up to 5.5mm (7)
- Factory fitted 100kΩ EOL & Series resistors specific to FloWatch monitoring panel (8) - Remove PCB Jumper if not in use
- Series or Parallel quick configuration (9)
- Normally open or Normally closed quick configuration (10)
- Push in Wago PCB wiring connectors (11)
- Supplied with 1x cable gland for connecting to Flowwatch or other alarm device
- QR code printed on the enclosure linked to product datasheet for ease of wiring details



Monitored Residential Riser Test and Drain Valve Pre-wired with Model 120 Ball Valve v4

BS 9251: 2021

Standards

Conforms to BS 9251: 2021

Working Pressure

Max. working pressure 12 bar

Max. Test pressure 18 bar

Connections

Inlet, Outlet and Drain port

Rp (BSP) threads in accordance with ISO7-1

Flow Switch Ports

Rp1 (1" BSP) threads in accordance with ISO7-1

Flow Switch


Potter VSR-S-EU Vane Type flow switch

- Flow Sensitivity Range: 15-38 LPM
- UL, CE Marked (EN 12259-5) LPCB Approved
- IP54 rating

For more information refer to Rapidrop datasheet 2.15


Model 120 Monitored Ball Valve

- 24V AC/DC
- IP54 - tested and certified as per BS EN 60529: 1992 + A2: 2013
- Configure as NO or NC switch contact

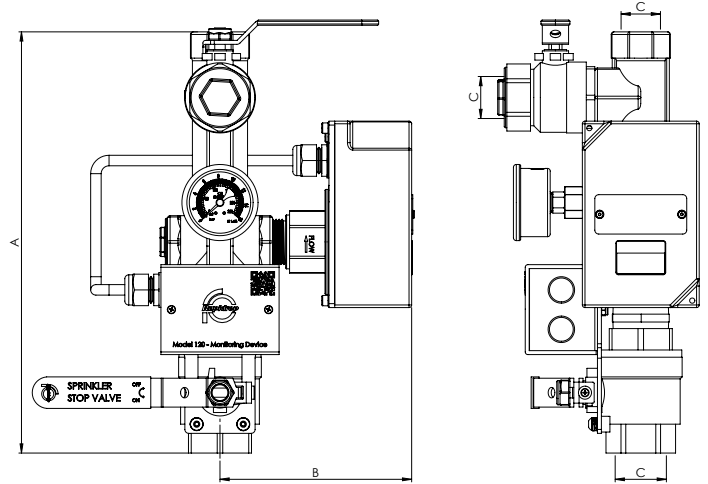

Dimensions

Riser Size	A	B	C	Ordering Codes
DN25 1"	298	135 ± 5	Rp1 (1" BSP)	RDMPWRES1120025V4
DN32 1-1/2"	320	140 ± 5	Rp1-1/4 (1 1/4" BSP)	RDMPWRES1120032V4
DN40 1-1/2"	344	145 ± 5	Rp1-1/2 (1 1/2" BSP)	RDMPWRES1120040V4
DN50 2"	383	155 ± 5	Rp2 (2" BSP)	RDMPWRES1120050V4

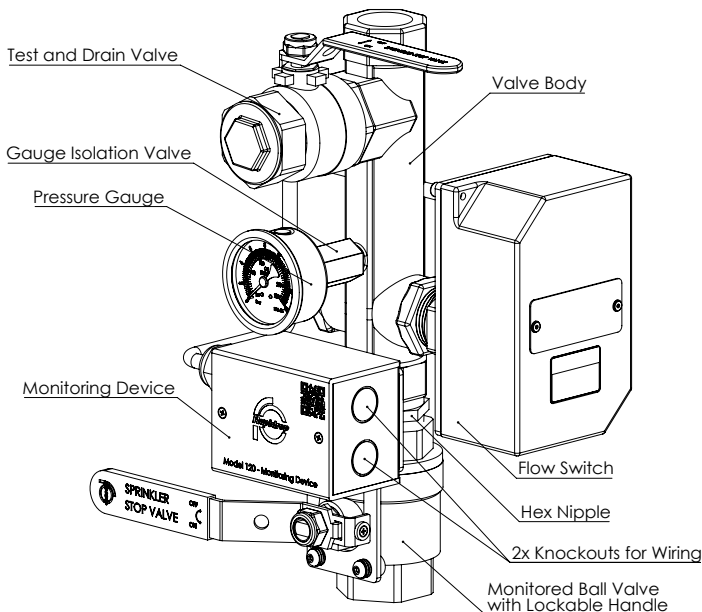

Material Specification

No.	Part	Material
1	Residential Riser Body	Brass HPb59-1 Nickel Plated
2	Monitored Ball Valve	Stainless Steel 304
3	Monitoring Switch Enclosure	ABS
4	Gauge Isolation Valve	Brass HPb59-1 Nickel Plated
5	Pressure Gauge	304 Stainless Steel Case
6	Hex Nipple	Brass HPb59-1

Optional Features


Additional security device of a padlock and alike key set. Compatible with any 6mm padlocks.

Ordering code: RDPAD25-KA02H

Monitored Residential Riser Test and Drain Valve Pre-wired with Model 120 Ball Valve v4

BS 9251: 2021

Flow Switch Installation Orientation

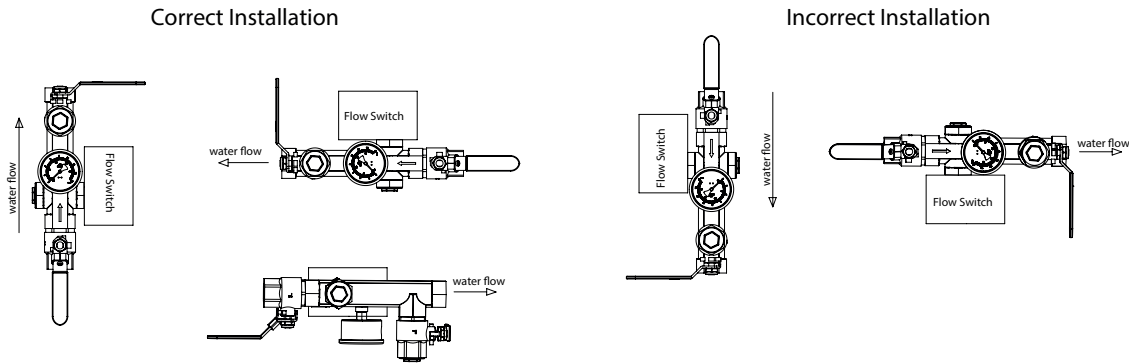

Installation Guide

The following notes are intended as a basic guide to assist installation and form part of the manufacturer's warranty.


- Ensure correct tools are used for installation, never use grip type tools on the manifold
- Always use pipe sealant compatible with all system components. If in doubts please consult manufacturer's product manual.
- Do not over tighten connecting fittings/components
- Assemble/Restrain the residential riser near to the joint being connected too
- To ensure the manifold is securely positioned, bracket within 150mm from top and bottom connections
- When installing consider access for maintenance and wiring
- Installation should always be carried out by a suitably qualified person

Note: Rapidrop residential riser assemblies contain internal joints that are factory sealed and pressure tested. Failure to correctly restrain the assembly during installation may damage the seal, lead to leakage and void warranty.

Installation of resistors


- Refer to wiring/ PCB jumper configuration for correct positioning of resistors
- Fig.A Press down on terminal connection and push in resistor. Once in position remove pressure. Resistor will lock in place (Within the Model 120 Enclosure)
- Fig.B Ensure resistor engages into terminal block (Within flow switch enclosure)

Use Resistor wire SWG 22 or SWG 24

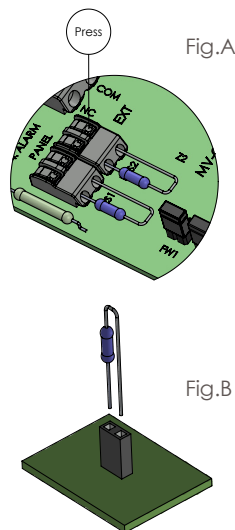

Knock out removal


- Always remove knock outs with the lid in place
- Push the knock out through by hand or alternatively cut using a knife
- Never use tools to force knock out through - This may cause damage of the internal PCB



Opening Enclosure Lid


- Undo 2 x lid screws
- Prize the lid away at the bottom. Lift outwards to clear the grooves.
- To install the lid, line the grooves and slide it down, until it engages at the bottom.

Note: Do not over bend the enclosure lid when lifting outwards



Configuration

Rapidrop Model 120 utilises PCB Jumpers to easily configure the circuit. Lift the female connectors and re-configure according to the alarm, monitoring system or pump controller you are connecting to.




Refer to Wiring/ PCB Jumper configuration section

Wiring Connectors

Push the wires in to the terminal to engage

Note: You will not need to press down onto the terminal.





Monitored Residential Riser Test and Drain Valve Pre-wired with Model 120 Ball Valve v4


BS 9251: 2021

Wiring/ PCB Jumper Configuration

Monitored valve (Seperate input)

Monitor the Isolation Valve Individually from the flow switch (Seperate Interfaces)

Refer to the alarm/ monitoring panel manufacturer for switch state/ resistor installation

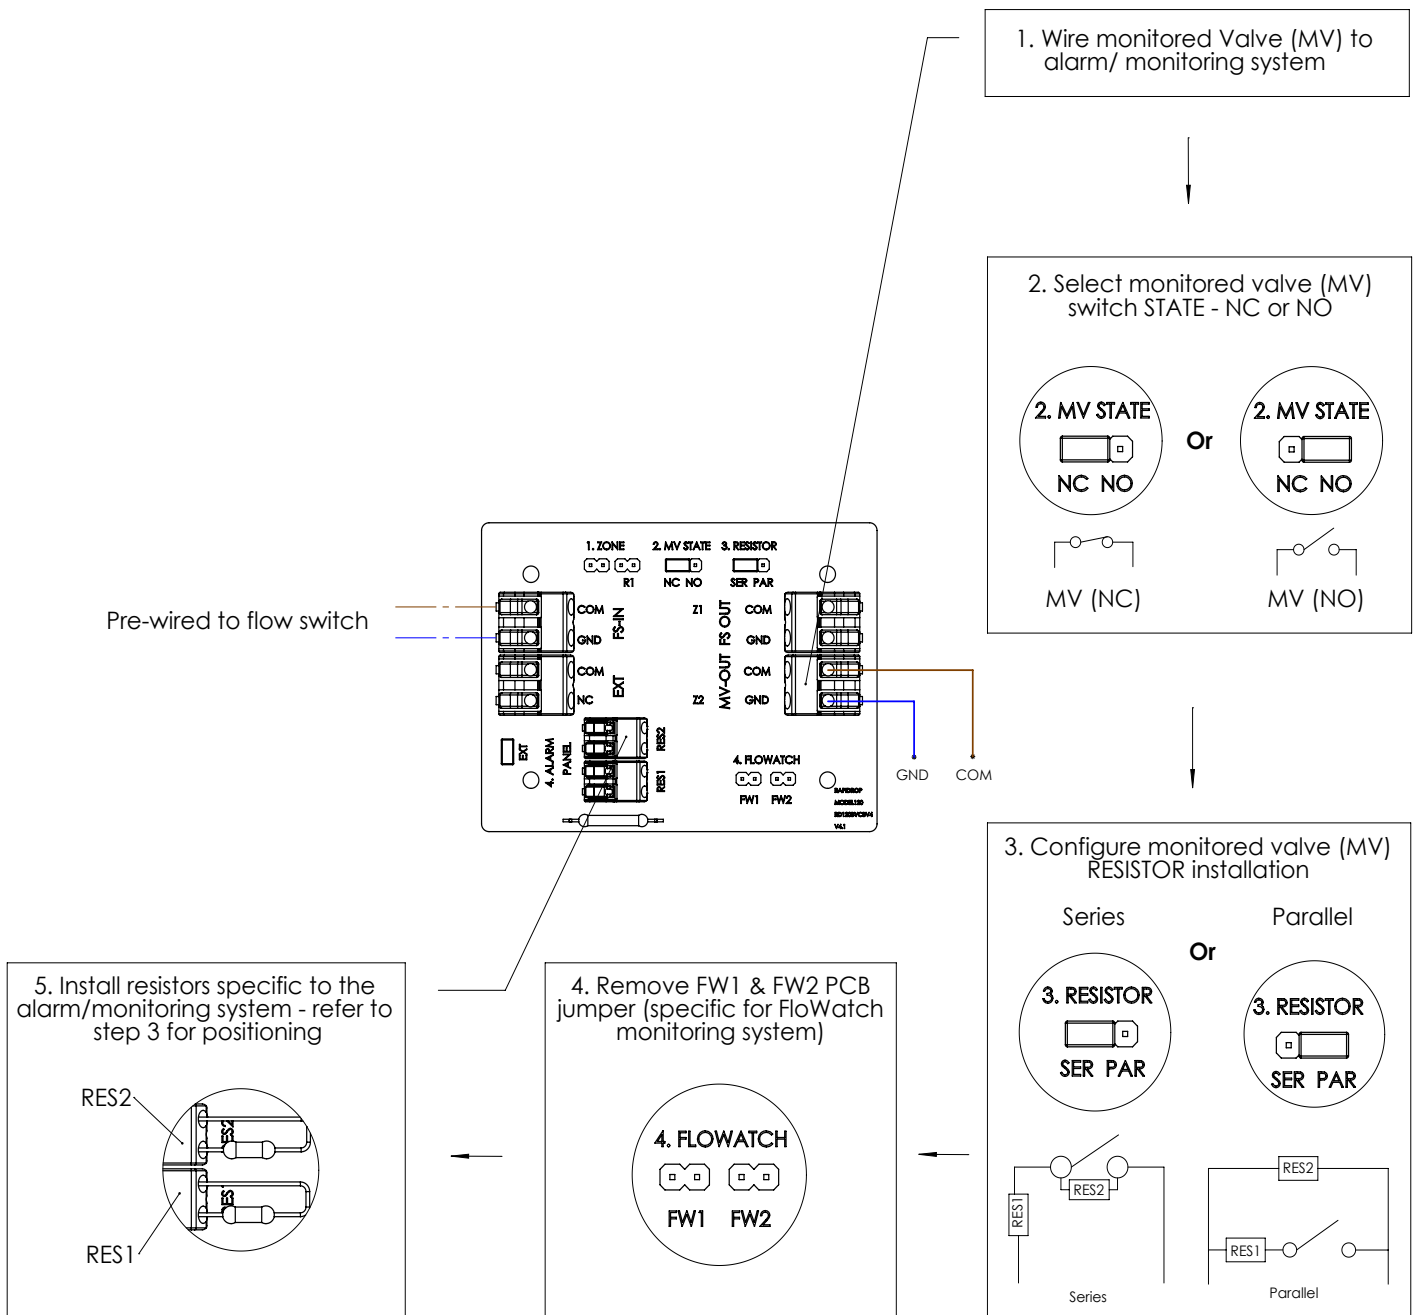




Monitored Residential Riser Test and Drain Valve Pre-wired with Model 120 Ball Valve v4

BS 9251: 2021

Flow Switch (Seperate input)

Monitor the flow switch Individually from the Isolation Valve (Seperate Interface)

Refer to the alarm/ monitoring panel manufacturer for switch state/ resistor installation

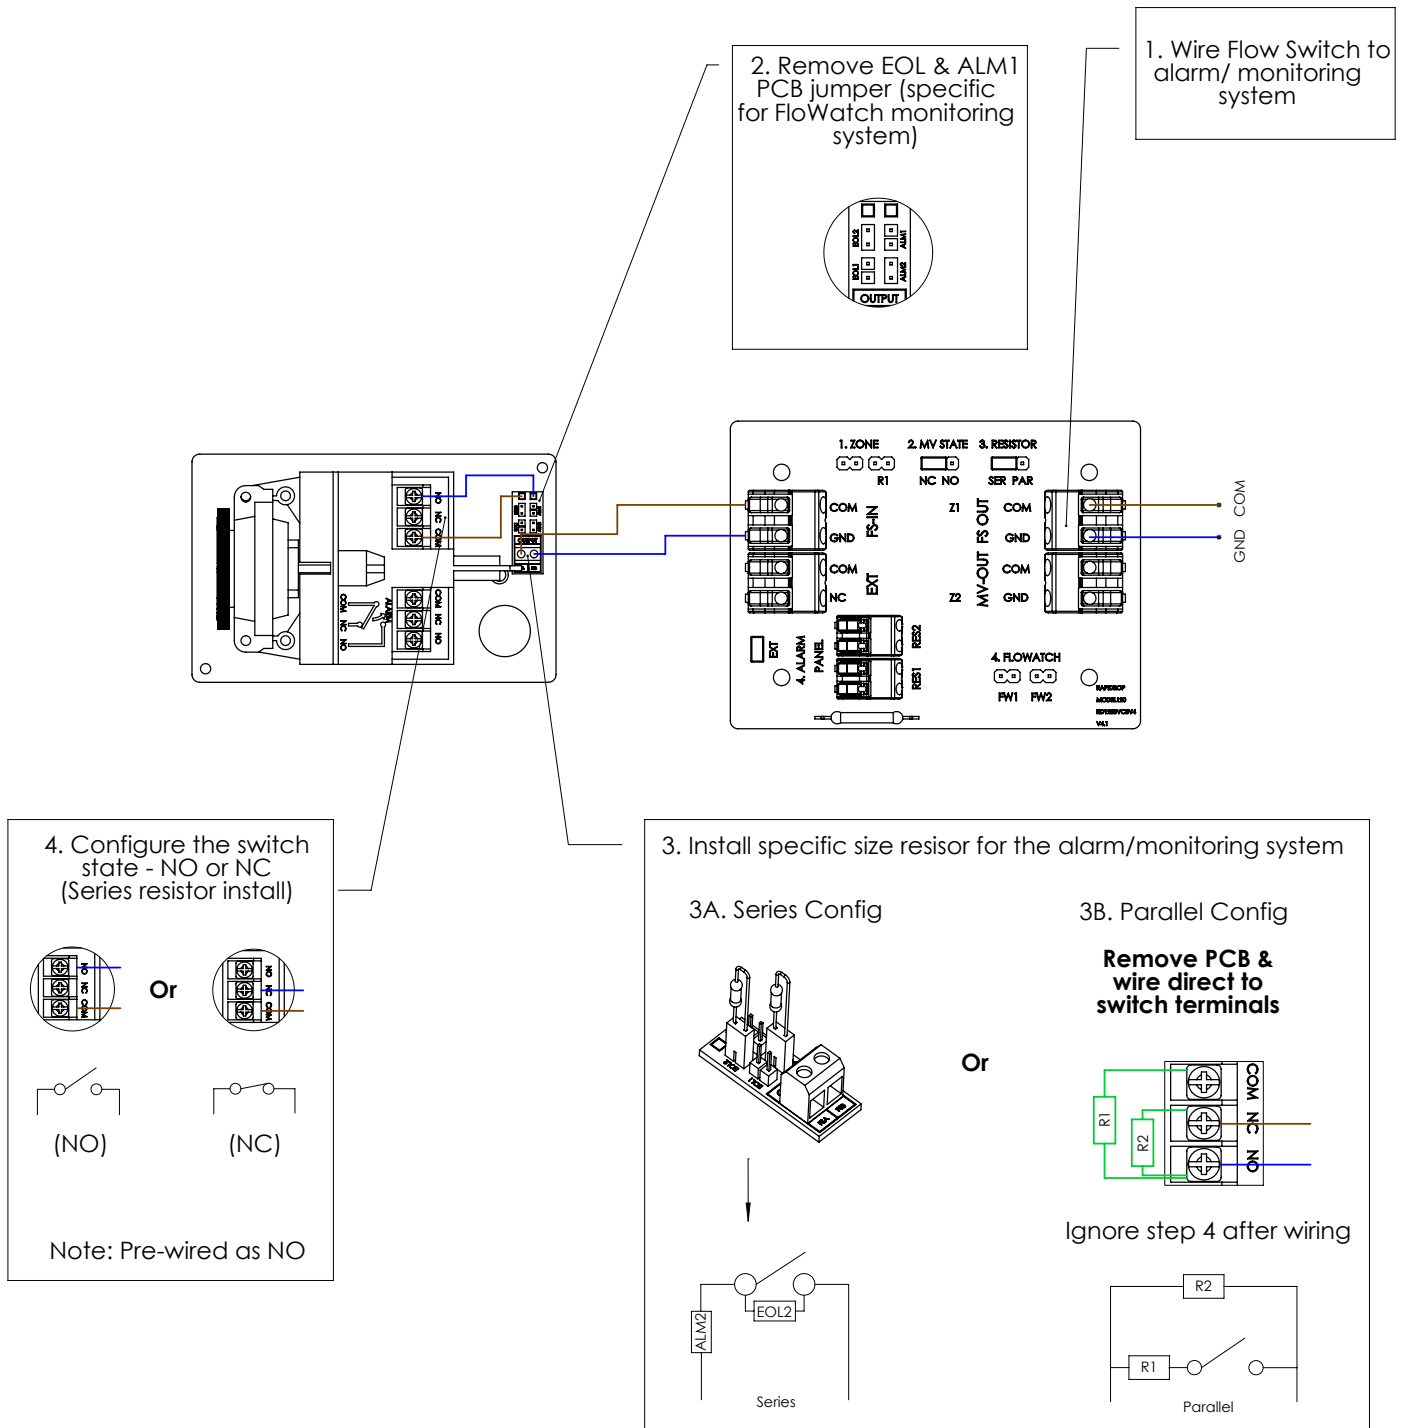




Monitored Residential Riser Test and Drain Valve Pre-wired with Model 120 Ball Valve v4

BS 9251: 2021

Flow Switch & Monitored Valve Combined input - Zone wiring

Combine the flow switch and Isolation valve onto a single interface. This should be wired in accordance with the building fire strategy. Rapidrop recommend monitoring each device separately to identify the mechanical and electrical fault/alarm of each component. Refer to the alarm/ monitoring panel manufacturer for switch state/ resistor installation

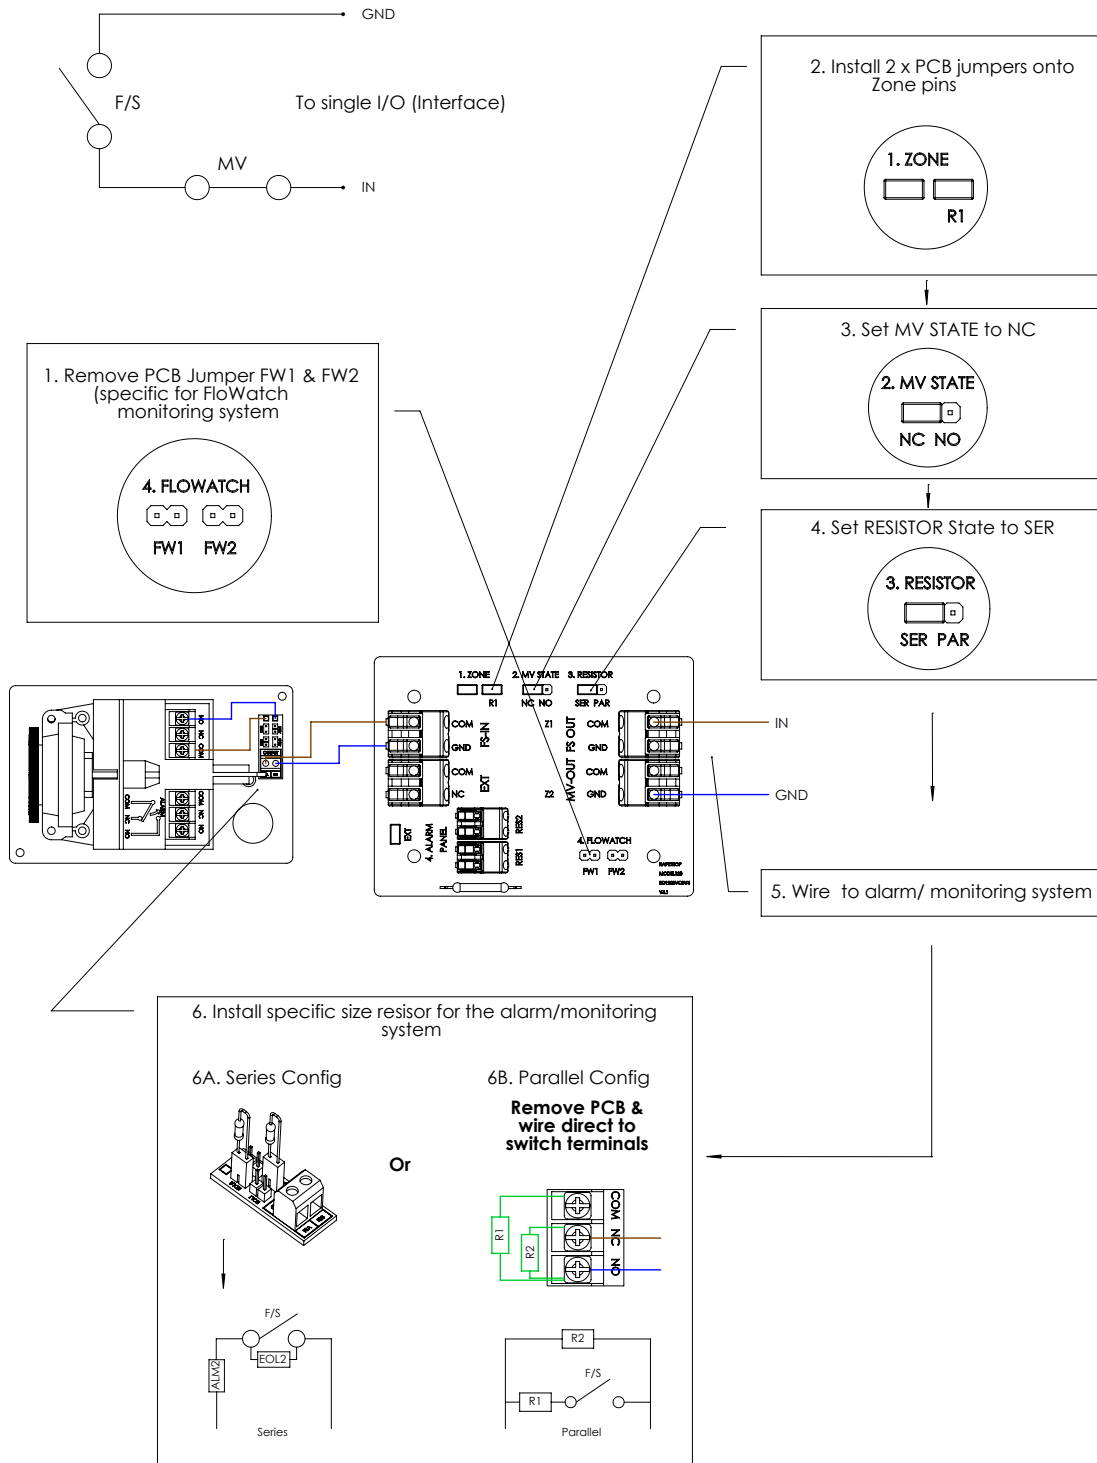



Monitored Residential Riser Test and Drain Valve Pre-wired with Model 120 Ball Valve v4






BS 9251: 2021

FloWatch Monitoring Panel Connection



Set Isolation Valve as NC in programming software

Set Flow switch as NO in programming software

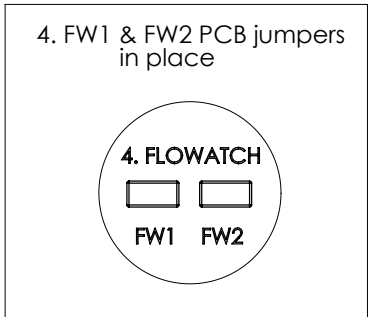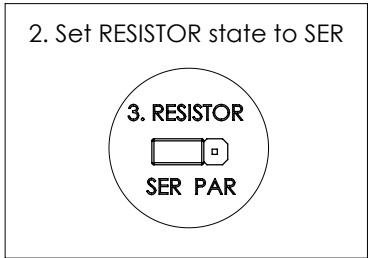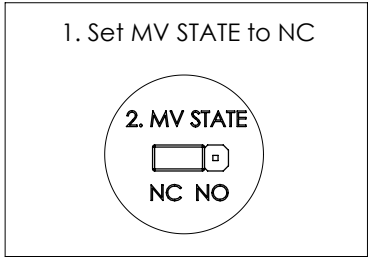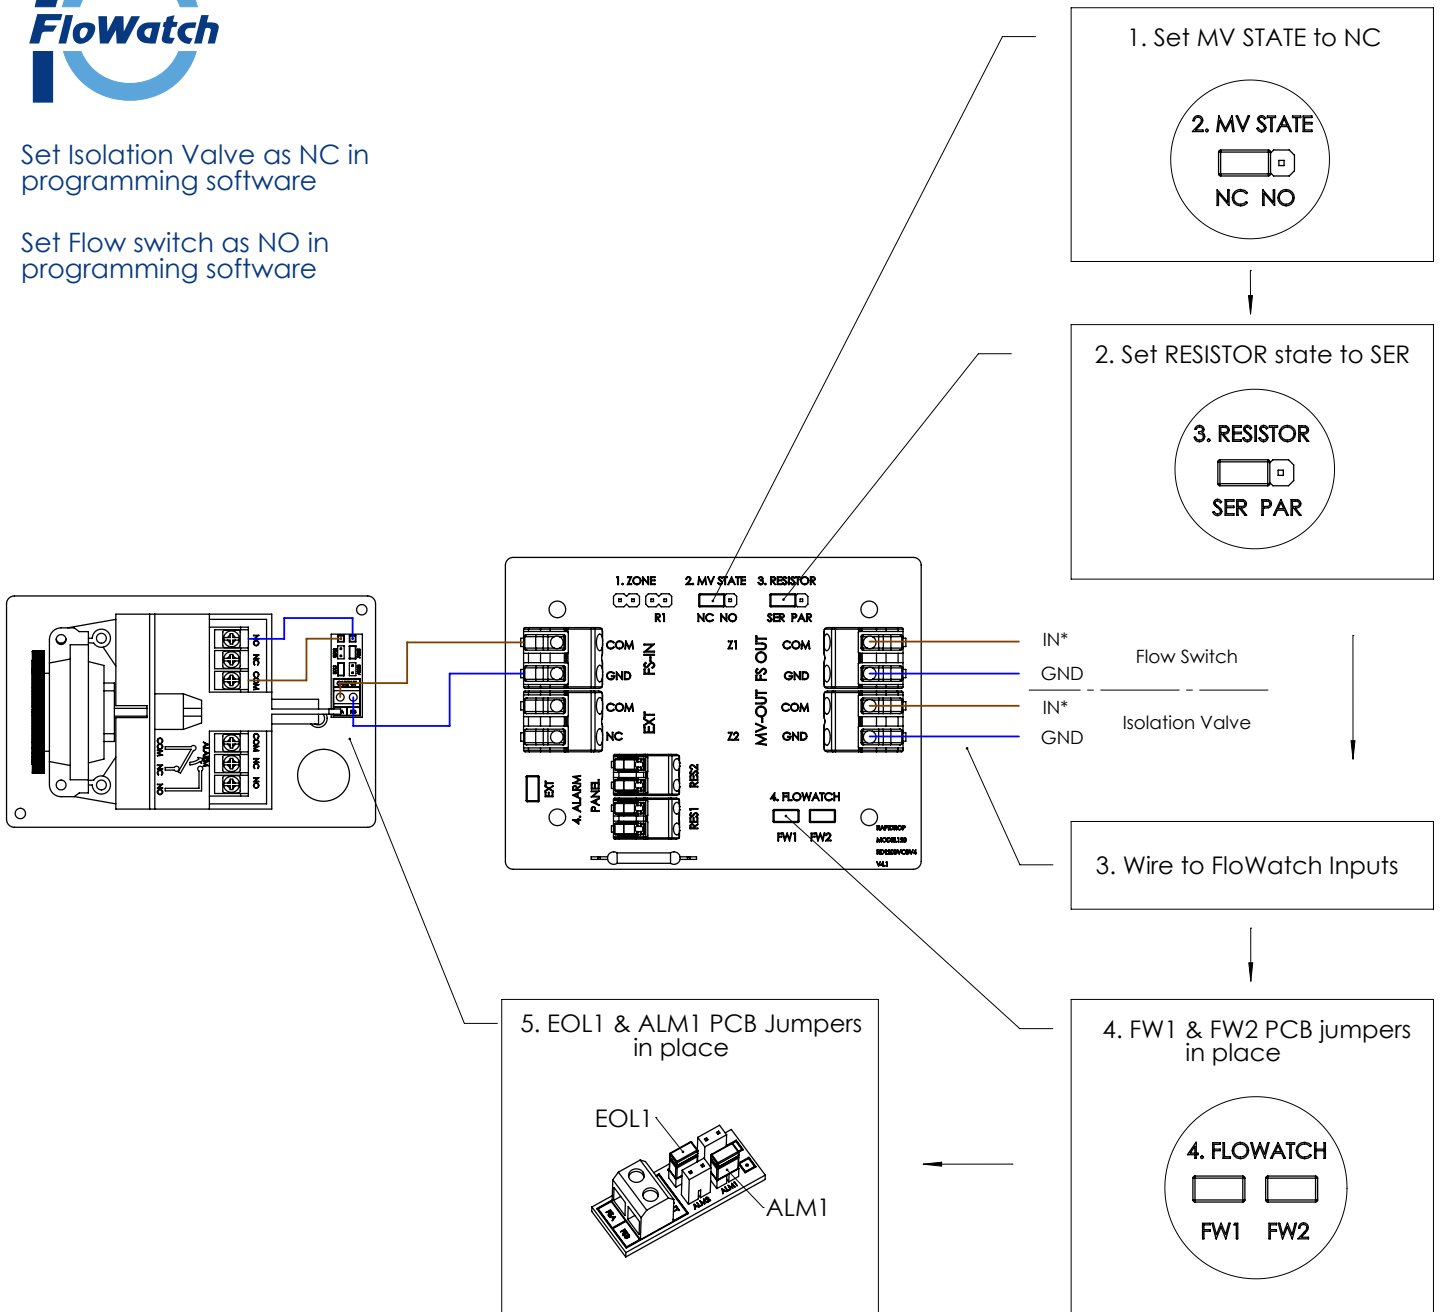



Monitored Residential Riser Test and Drain Valve Pre-wired with Model 120 Ball Valve v4


BS 9251: 2021

Additional features

Additional external switch - Daisy chain monitored valve input

External switch connection allows an additional input to be connected onto the same zone/ circuit


Note: The devices will be linked on the same NC circuit (Not independent)

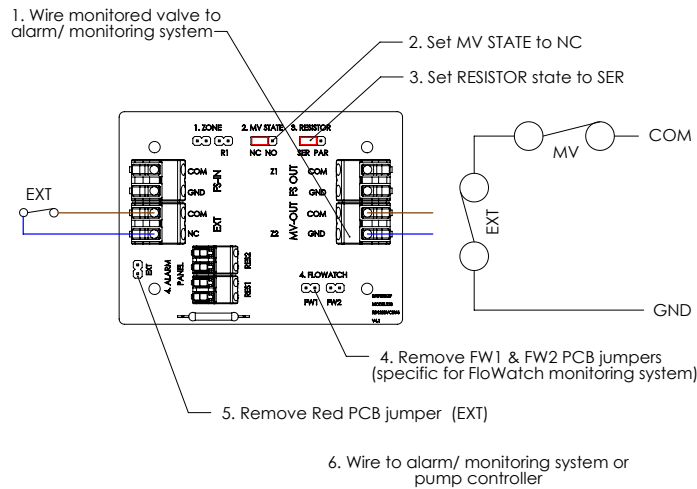


Pump controller Connection - No Resistors

Pump controllers typically utilise voltage circuits rather than resistance. Refer to the below for connection to monitored valve and flow switch. Refer to the pump controller for NC or NO Switch states

Monitored Valve

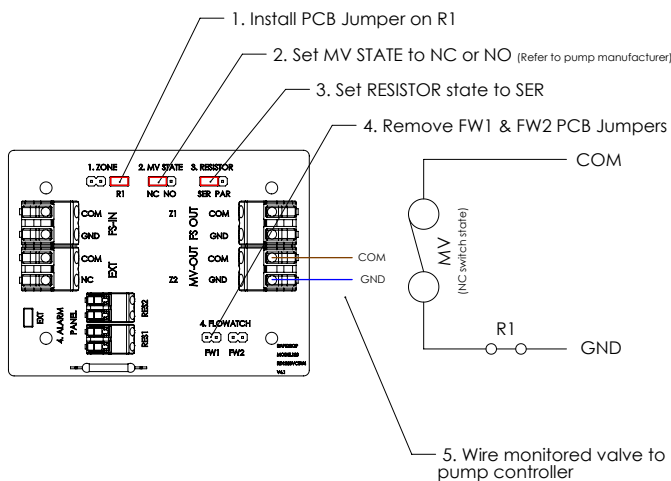

Flow switch

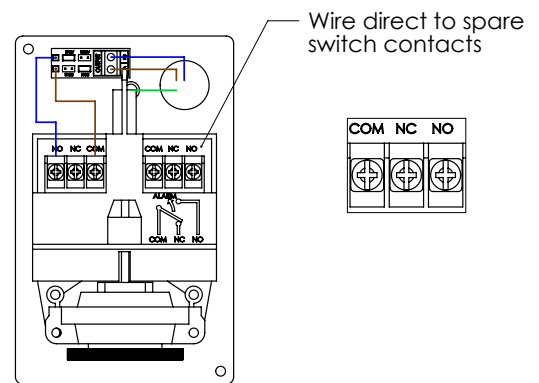

Flowswitch enables connection to alarm panel & pump controller. Refer to pump controller manufacture for NO or NC contact

Maintenance

Rapidrop Model 120 monitored ball valve requires no regular maintenance, however it is advisable to inspect and verify proper operation of the unit annually or in accordance with the authority having jurisdiction.

The inspection should include, but not limited to:

- Verify operation of the tamper switch
- Inspection of magnet (Clean with soapy water if contaminated with external debris)
- Ensure switch enclosure is secure